

# Optimisation of Biomass Waste to Energy Conversion Systems for Rural Grid-Connected Applications

R. Namuli<sup>a,\*</sup>, B. Jaumard<sup>b</sup>, A. Awasthi<sup>c</sup>, P. Pillay<sup>a</sup>

<sup>a</sup>Department of Electrical and Computer Engineering, Concordia University, 1515 St. Catherine West, S-EV005.139, Montreal, Quebec, Canada H3G 2W1

<sup>b</sup>Department of Computer Science and Software Engineering, Concordia University, Montreal, Quebec, Canada

<sup>c</sup>Concordia Institute of Information Systems Engineering, Concordia University, Montreal, Quebec, Canada

---

## Abstract

Several rural farms have installed anaerobic digestion systems as manure management systems. Such systems are also used to provide electricity and heating. In these systems, biogas is generated from anaerobic digestion of biomass waste and combusted in a boiler and an engine-generator set, to produce heat and electricity respectively. This paper calculates the size and mode of operation of a biomass waste to energy conversion system that would result in maximum revenue for a given herd size. A Tabu Search optimisation technique is used. A number of equally good solutions are generated. These solutions are plotted on a Pareto front and the best solution is defined as one that lies on this Pareto front. Optimisation of a biomass waste to energy conversion system reduces reliance on electricity from the grid. It also reduces reliance on the use of propane or other fossil fuels for heating.

*Keywords:* biomass waste, energy conversion, Tabu Search, optimisation

---

## 1. Introduction

Several rural farms around the world have installed anaerobic digestion systems as manure management systems. Such systems are also used to generate electricity and heat. Problems faced with existing systems stem from poor sizing and operation of the biomass waste to energy conversion systems. The objective of the optimisation being carried out is to determine the maximum revenue that can be obtained from these systems, for a given herd size. Revenue is maximised by optimal sizing and operation of the system. This minimises production of excess biogas and also reduces capital costs and the payback period. Maximisation of revenue from such a system will be a result of savings from avoided usage of grid electricity, revenue from selling electricity to the grid and savings from reduced heating costs.

The work is motivated from farms that have faced the problems in the implementation of these systems. Clover Hill Dairy had to upgrade to a 300 kW engine-generator set because of production of excess biogas [1]. Green Valley Dairy [1], Lamb Farms [2], Sunnyside Farms [3] and Swiss Valley Farms [4] flared excess biogas generated. A.A. Dairy farm installed a biomass waste to energy conversion system at a cost of USD 363,000 [5]. The system's estimated payback period was 6 years [6]. Sheland Farms spent USD 1,320,968 [7] on their

biomass waste to energy conversion system that had an estimated payback period of 16 years [8]. The Klaesi Brothers Farm has a biomass waste to energy conversion system that cost CAD 290,000 and had a payback period of 10 years [9].

A Tabu Search technique (see [10, 11]) is used for optimisation. The Tabu Search technique has not been applied before for optimisation of biomass to energy conversion systems. In [12] mixed integer linear programming was used to optimise the utilisation of waste heat from industries. An evolutionary strategy was used to determine the optimal choice of compressor power ratings, effluent mass flow rate and volume of storage tanks in a heat pump system in [13]. In [14] genetic algorithms and sequential quadratic programming were used to optimise a multi-biomass tri-energy supply system. In [15] the energy production process for a biomass based system was optimised using mixed integer linear programming and mixed integer non-linear programming. The Tabu Search technique was chosen for two reasons: (i) the biomass waste to energy conversion system has a very large solution space and (ii) the system is complex and computationally demanding. Variables that impact on the objective function are used, in the optimisation. The solution space has a total of 1,261,656 variables. Although the variables are discrete, the problem cannot be solved by enumeration of potential solutions due to the large number of combinations of variables. In addition, the optimisation problem being solved is a non-linear constrained problem. The system comprises of functions used to determine the electricity and heat generated. The problem is computationally complex and has many local optima. The problem is therefore better suited to a heuristic approach of problem solving [16]. The choice of which heuristic to use was

---

\*Corresponding author. Tel.:+1 5145590354; fax:+1 5148482802.

Email addresses: r\_namuli@encs.concordia.ca (R. Namuli), bjaumard@cse.concordia.ca (B. Jaumard), awasthi@ciise.concordia.ca (A. Awasthi), pillay@encs.concordia.ca (P. Pillay)

between population based heuristics like genetic algorithms, and trajectory based heuristics like Tabu Search. In population based heuristics a whole set of solutions is updated simultaneously, whereas in trajectory based heuristics single solutions are evaluated and updated [16]. Population based heuristics are more efficient with regard to exploring the whole space [16], however they are computationally expensive. Trajectory based heuristics are more suited to computationally demanding problems. The Tabu Search technique was chosen in particular because it is good for exploring a discrete search space with a finite set of neighbouring solutions [16]. This is the case for the optimisation problem being solved. The optimisation technique of this paper is an improvement on research work done so far in solving optimisation problems of biomass energy conversion systems. The other sections of this paper give details of the use of the Tabu Search technique. Section 2 of the paper describes the biomass waste to energy conversion system. Section 3 explains the choice of the optimisation technique. The results of the optimisation are given in Section 4, and Section 5 is on conclusions arrived at.

## 2. Description of Models of the Biomass Waste to Energy Conversion System

This section describes the biomass waste to energy conversion system being optimised. A system diagram of the biomass waste to energy conversion system is shown in Figure 1. The system model consists of a digester, a lagoon, an internal combustion engine, an induction generator, a boiler, a propane tank, a heat exchanger and the electricity grid. The source of biomass waste is dairy farm manure. Manure is stored in a lagoon that allows for variation of flow into the digester. Biogas is generated from the anaerobic digestion of the manure in the digester and combusted in an internal combustion engine to generate torque. The torque is applied to an induction generator to produce electricity. Some of the biogas generated is combusted in a boiler to produce heat. The exhaust heat from the internal combustion engine is captured by a heat exchanger. A propane tank is included in the system to provide a backup fuel supply. This is in the event that biogas generated is insufficient to run both the generator and the boiler, to meet the heating demand. The electricity grid connection is included since excess electricity can be sold to the grid or electricity can be obtained from the grid. The digester requires heating, which is obtained from the system. The following is a description of the modeling of the components of the biomass waste to energy conversion system.

A plug flow digester is used. It is modeled as four continuous stirred tank reactors [17, 18]. A mass balance analysis is carried out on each of the waste components in the digester. The waste components undergo disintegration, hydrolysis, bacterial death, acidogenesis, acetogenesis or methanogenesis. Disintegration, hydrolysis and bacterial death are each expressed by:

$$r = kX_a \quad \text{kgCOD/m}^3/\text{day}, \quad (1)$$

where  $r$  is the rate of accumulation of particulate substrate,  $X_a$  is the concentration of active biomass and  $k$  is a first order rate coefficient.  $\text{kgCOD/m}^3$  is the chemical component base unit used to model the anaerobic digestion process [17]. COD is the mass of oxygen required to completely oxidise a given organic compound. Acidogenesis, acetogenesis and methanogenesis are each expressed by:

$$\rho = k_m S X_a I / (K + S) \quad \text{kgCOD/m}^3/\text{day}, \quad (2)$$

where  $S$  is the concentration of the substrate,  $K$  is the concentration of the substrate giving one-half the maximum rate of substrate utilisation,  $\rho$  is the rate of substrate utilisation,  $k_m$  is the maximum specific rate of substrate utilisation and  $I$  is a modifier that describe the inhibition of the reactions. Equations (1) and (2) are used to formulate the mass balance equations of the anaerobic digestion process as:

$$\frac{dS_{\text{liq}}}{dt} = \frac{q_{\text{in}} S_{\text{in}} - q_{\text{out}} S_{\text{liq}}}{V_{\text{liq}}} + \rho \nu \quad \text{kgCOD/m}^3/\text{day}, \quad (3)$$

$$\frac{dS_{\text{gas}}}{dt} = -\frac{q_{\text{gas}} S_{\text{gas}}}{V_{\text{gas}}} + \rho \frac{V_{\text{liq}}}{V_{\text{gas}}} \quad \text{kgCOD/m}^3/\text{day}, \quad (4)$$

where  $S_{\text{liq}}$  is the liquid components concentration,  $q_{\text{in}}$  is the volume flow rate of manure influent,  $S_{\text{in}}$  is the concentration of manure influent,  $q_{\text{out}}$  is the volume flow rate of manure effluent,  $V_{\text{liq}}$  is the volume of liquid in the digester,  $\rho$  is the rate of substrate utilisation,  $\nu$  is the stoichiometric coefficient,  $S_{\text{gas}}$  is the biogas components concentration,  $q_{\text{gas}}$  is the volume flow rate of biogas in the digester and  $V_{\text{gas}}$  is the volume of biogas in the digester. The mass flow rate of biogas is required for determination of energy converted to heat and electricity. This is calculated from the volume flow rate (4) and the density of the biogas. The density of the biogas is calculated from the pressure of the biogas, using the ideal gas law. The pressure of the biogas is the sum of the partial pressures of the biogas components and water vapour in the head space of the digester. The ideal gas law is also used to calculate the partial pressures of the biogas components. The partial pressure of the water vapour is calculated by:

$$p_{\text{gas,H}_2\text{O}} = 0.0313 \exp(17.75(T - 298)/T) \quad \text{bar}, \quad (5)$$

where  $p_{\text{gas,H}_2\text{O}}$  is the partial pressure of water vapour and  $T$  is the temperature of the biogas. In addition to the mass flow rate of the biogas, the air-fuel ratio and the LHV (Lower Heating Value) of the biogas are required to calculate torque and exhaust heat generated in the internal combustion engine. The air-fuel ratio of biogas is computed by:

$$AF = 4.76(2x_1 + 0.5x_3)M_{\text{air}}/M_{\text{biogas}}, \quad (6)$$

where  $AF$  is the air-fuel ratio of the biogas,  $x_1$  and  $x_3$  are the molar fractions of  $\text{CH}_4$  and  $\text{H}_2$  respectively,  $M_{\text{air}}$  is the molecular mass of a standard composition of dry air and  $M_{\text{biogas}}$  is the

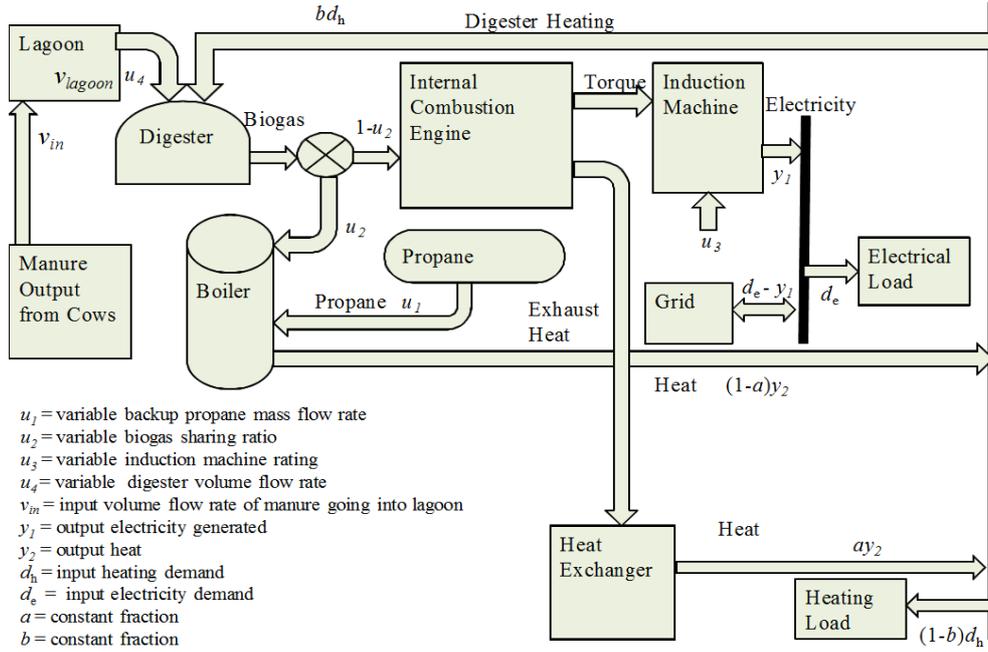


Figure 1: Biomass Waste to Energy Conversion System Model

147 molecular mass of the biogas. The heat of combustion of the  
 148 reactants in the digester is used to compute the LHV of biogas  
 149 as:

$$LHV_{\text{biogas}} = hrp/M_{\text{biogas}} \quad \text{kJ/kg}, \quad (7)$$

150 where  $LHV_{\text{biogas}}$  is the Lower Heating Value of biogas,  $hrp$   
 151 is the heat of combustion of the reactants in the digester and  
 152  $M_{\text{biogas}}$  is the molecular mass of biogas.

153 The torque generated is applied to an induction generator  
 154 to produce electricity. The induction generator ratings used in  
 155 the optimisation are matched with internal combustion engines  
 156 of similar ratings. The internal combustion engine models are  
 157 obtained from the ADVISOR software. The John Deere nat-  
 158 ural gas engine model contained in the ADVISOR software is  
 159 used to calculate engine power ratings that match the differ-  
 160 ent induction generator ratings. A fuel use map is given in the  
 161 ADVISOR software. This map gives fuel use at corresponding  
 162 torque and speed. A user is able to change the torque scale to  
 163 obtain fuel use for engines of different power ratings. This is  
 164 because the ADVISOR software specifies the maximum torque  
 165 at each speed. The user can specify the maximum torque at a  
 166 required speed in order to match the required induction gener-  
 167 ator rating. ADVISOR software redefines the torque scale based  
 168 on the maximum torque specified. The redefined torque scale,  
 169 the mass flow rate of the biogas, the LHV of the biogas, the  
 170 air-fuel ratio of the biogas and the engine speed are interpo-  
 171 lated to obtain the torque output. The torque output is used in  
 172 an induction machine model to calculate the electricity output.  
 173 The induction machine model is simulated [19] using:

$$v_{sd} - R_s i_{sd} + \omega_d (L_s i_{sq} + L_m i_{rq}) - L_m \frac{di_{rd}}{dt} = L_s \frac{di_{sd}}{dt} \quad \text{V}, \quad (8)$$

$$v_{sq} - R_s i_{sq} - \omega_d (L_s i_{sd} + L_m i_{rd}) - L_m \frac{di_{rq}}{dt} = L_s \frac{di_{sq}}{dt} \quad \text{V}, \quad (9)$$

$$v_{rd} - R_r i_{rd} + \omega_{dA} (L_m i_{sq} + L_r i_{rq}) - L_m \frac{di_{sd}}{dt} = L_r \frac{di_{rd}}{dt} \quad \text{V}, \quad (10)$$

$$v_{rq} - R_r i_{rq} - \omega_{dA} (L_m i_{sd} - L_r i_{rd}) - L_m \frac{di_{sq}}{dt} = L_r \frac{di_{rq}}{dt} \quad \text{V}, \quad (11)$$

$$P_{\text{mech}} = v_{sd} i_{sd} + v_{sq} i_{sq} \quad \text{W}, \quad (12)$$

174 where  $v_{sd}$ ,  $v_{sq}$ ,  $v_{rd}$  and  $v_{rq}$  are  $dq$  voltages,  $i_{sd}$ ,  $i_{sq}$ ,  $i_{rd}$  and  $i_{rq}$  are  
 175  $dq$  currents,  $\omega_d$  is the instantaneous speed of the  $dq$  winding,  
 176  $\omega_{dA}$  is the instantaneous speed of the  $dq$  winding with respect  
 177 to the rotor axis,  $P_{\text{mech}}$  is the output power of the induction  
 178 machine,  $R_s$  is the stator winding resistance,  $R_r$  is the rotor  
 179 winding resistance,  $L_m$  is the stator magnetizing reactance,  $L_s$   
 180 is the stator leakage inductance and  $L_r$  is the rotor leakage in-  
 181 ductance.

182 The exhaust heat captured by the heat exchanger is calcu-  
 183 lated as:

$$Q_{\text{HEX}} = \eta_{\text{HEXeff}} m_{\text{exh}} cp_{\text{exh}} (T_{\text{exh}} - T_{\text{water}}) \quad \text{W}, \quad (13)$$

184 where  $Q_{\text{HEX}}$  is the heat from the heat exchanger,  $\eta_{\text{HEXeff}}$  is the  
 185 efficiency of the heat exchanger,  $m_{\text{exh}}$  is the mass flow rate of  
 186 the exhaust from the internal combustion engine,  $cp_{\text{exh}}$  is the  
 187 specific heat capacity of the exhaust from the internal combus-  
 188 tion engine,  $T_{\text{exh}}$  is the temperature of the exhaust from the

internal combustion engine,  $T_{\text{water}}$  is the temperature of water in the heat exchanger.

It is assumed that a dual fuel boiler is used. The heat output of the boiler is obtained by:

$$Q_{\text{boiler}} = (u_1 LHV_{\text{propane}} + u_2 m_{\text{biogas}} LHV_{\text{biogas}}) \eta_{\text{boiler}} \quad \text{W}, \quad (14)$$

where  $Q_{\text{boiler}}$  is the heat output of the boiler,  $u_1$  is the variable mass flow rate of backup propane,  $LHV_{\text{propane}}$  is the Lower Heating Value of propane,  $u_2$  is the variable biogas sharing ratio,  $m_{\text{biogas}}$  is the mass flow rate of biogas from the digester,  $LHV_{\text{biogas}}$  is the Lower Heating Value of biogas and  $\eta_{\text{boiler}}$  is the efficiency of the boiler.

The total heat output of the biomass waste to energy conversion system,  $y_2$  is the sum of the boiler's and the heat exchanger's outputs.

A monthly heating demand profile is generated based on the number of cows. Heating demand on dairy farms comprises of space heating needs of the milking parlour, hot water for cleaning, and the digester's heating requirements. The space heating needs of the milking parlour are estimated using the software HOT2000 from Natural Resources Canada. The software takes into consideration the monthly variation in temperature. Weather data from Binghamton weather station in New York state is used for space heating needs estimation. This is the closest weather station to the sample farm used in the case study. Hot water needs are estimated from studies carried out on milking parlour heating needs of dairy farms [20, 21]. The digester's heating requirement is modeled based on the heat losses from the walls, roof and floor of the digester. The heat required to raise the temperature of influent manure to the operating temperature of the digester is also included.

The boiler rating is determined from the heat demand by:

$$b_r = \max(d_h) - Q_{\text{HEX}} + \delta_b \quad \text{W}, \quad (15)$$

where  $b_r$  is the boiler rating,  $\max(d_h)$  is the maximum heat demand,  $Q_{\text{HEX}}$  is the heat exchanger output that corresponds to the maximum heat demand and  $\delta_b$  is an allowance for the boiler rating.

Electrical energy demand is obtained from a typical dairy farm in New York State [6].

The modeling of the components of the biomass waste to energy conversion system has been described in this section. The optimisation methodology is described next in Section 3.

### 3. Optimisation Technique

This section describes the formulation of the optimisation problem. The objective function, the optimisation variables, inputs, outputs and parameters are defined. The optimisation strategy is also described.

#### 3.1. Objective Function

The objective of the optimisation is to maximise revenue from a biomass waste to energy conversion system for a given herd size. The objective function is expressed as:

$$z = \min(C_{\text{capital}} + C_{\text{propane}} - C_{\text{incentives}} + C_{\text{grid.electricity}}), \quad (16)$$

where  $z$  is the minimal cost,  $C_{\text{capital}}$  is the capital cost amortized monthly,  $C_{\text{propane}}$  is the monthly cost of backup propane,  $C_{\text{incentives}}$  is the value of incentives given monthly for generation of renewable energy and  $C_{\text{grid.electricity}}$  is the monthly cost of electricity obtained or sold to the grid.

#### 3.2. Optimisation Variables, Inputs, Outputs and Parameters

The four variables selected for use in the optimisation are given in Table 1 and shown in Figure 1.

Table 1: Variables of the Optimisation

Variable	Range
$u_1$ backup propane mass flow rate	0 - 0.0036 kg/s
$u_2$ biogas sharing ratio	0 - 0.99
$u_3$ induction machine rating	10, 20, 50, 150, 200, 250 hp
$u_4$ digester volume flow rate	0 - 59 m <sup>3</sup> /day

The maximum value of backup propane mass flow rate ( $u_1$ ) is obtained from the propane flow rate that meets the maximum heat demand when the boiler is combusting propane only, and when the system is operating at the maximum digester volume flow rate. This is because heating is required to raise the temperature of influent manure to the operating temperature of the digester. The biogas sharing ratio ( $u_2$ ) is the ratio of biogas sent to the boiler. In selection of the maximum value of the biogas sharing ratio, it is ensured that biogas is sent to the engine for electricity generation at all times. The ratings of the induction generator ( $u_3$ ) are based on induction generators currently operational on dairy farms. The maximum value of the digester volume flow rate ( $u_4$ ) is determined using:

$$u_4^{\text{max}} = v_{\text{in}}(n_{\text{days.max}} + n_{\text{lagoon.storage}})/n_{\text{days.max}} \quad \text{m}^3/\text{day} \quad (17)$$

where  $u_4^{\text{max}}$  is the maximum digester volume flow rate,  $v_{\text{in}}$  is the volume flow rate of manure from the cows,  $n_{\text{days.max}}$  is the maximum number of days in a month and  $n_{\text{lagoon.storage}}$  is the initial lagoon storage capacity in days. The volume flow rate of manure from the cows is determined from [22].

The inputs and outputs of the system model are given in Table 2 and shown in Figure 1.

The parameters of the optimisation are given in Table 3.

<sup>1</sup>[23]

<sup>2</sup>[24]

<sup>3</sup>[25]

Table 2: Inputs and Outputs of the Optimisation

Input/Output	Description
$d_h$	input heating demand (kW)
$d_e$	input electricity demand (kW)
$v_{in}$	input volume flow rate of manure (m <sup>3</sup> /day)
$y_1$	output electricity generated (kW)
$y_2$	output heat generated (kW)
$b_r$	output boiler rating (kW)

Table 3: Parameters of the Optimisation

Parameter	Description	Value
$n_{days\_max}$	maximum days in a month	31 days
$n_{lagoon\_storage}$	initial lagoon storage capacity	35 days
$n_{max\_stop}$	number of iterations for stopping condition	150 iterations
$\delta_b$	boiler rating allowance	10 kW
$\delta_h$	heating demand allowance	15 kW
$C_{cap\_in}$	capacity incentive	1000 \$/kW <sup>1</sup>
$\max(C_{cap\_in})$	maximum capacity incentive	\$850000 or 50% of engine cost <sup>1</sup>
$x_{inc}$	performance incentive	0.07 \$/kWh <sup>1</sup>
$x_{anc}$	factor for ancillary works	1.15
$p$	number of payments of capital cost	240
$r$	interest rate	12%
$c_{lagoon}$	unit cost of unlined lagoon	2.47 \$/m <sup>3</sup> <sup>2</sup>
$c_{propane}$	unit cost of propane	1.98 \$/m <sup>3</sup> <sup>3</sup>

### 3.3. Computation of Costs of the Objective Function

This section describes the calculation of the cost components of the objective function.

The capital expenditure includes building of a digester and lagoon and purchase of a boiler and engine-generator set. Estimation of the cost of building a digester and purchase of an engine-generator set is based on a literature review [26, 27, 28, 29] and is given in Table 4 and 5. Estimation of the cost of the boiler is based on a literature review [30] and is given in Table 6. The total capital expenditure on the biomass waste to energy conversion system is expressed as:

$$C_{cost} = (d_{cost} + g_{cost} + lg_{cost} + b_{cost} - C_{cap\_in})x_{anc} \quad \$, \quad (18)$$

where  $C_{cost}$  is the total capital expenditure,  $d_{cost}$  is the cost of the digester,  $g_{cost}$  is the cost of the engine generator set,  $lg_{cost}$  is the cost of the lagoon,  $b_{cost}$  is the cost of the boiler,  $C_{cap\_in}$  is the capacity incentive and  $x_{anc}$  is a factor for ancillary works. The total capital expenditure is amortized monthly by:

$$C_{capital} = rC_{cost}/(1 - (1/(1 + r))^p) \quad \$, \quad (19)$$

where  $C_{capital}$  is the capital cost amortized monthly,  $r$  is the annual interest rate,  $C_{cost}$  is the capital expenditure and  $p$  is the number of payments.

The cost of electricity from the grid is computed based on the electricity tariff [31] and electricity demand [6]. The user may

Table 4: Cost Estimates for Plug Flow Digesters

Digester Size Range (m <sup>3</sup> )	Cost (\$)
900 - 1200	95,000
1200 - 1500	125,000
1500 - 1800	200,000
1800 - 2100	290,000

Sources: The Minnesota Project 2002, Eastern Research Group, Inc. 2004 & 2005, Resource Strategies, Inc. 2004.

Table 5: Engine-generator Set Cost Estimates

Engine-generator Set Rating (hp)	Cost (\$)
10	30,000
20	40,000
50	80,000
150	250,000
200	300,000
250	330,000

Sources: The Minnesota Project 2002, Eastern Research Group, Inc. 2004 & 2005, Resource Strategies, Inc. 2004.

sell electricity generated from biogas, to the utility company. Net metering is also an option whereby the value of electrical energy sent to the grid is subtracted from the user's monthly electricity bill.

The objective function also includes a cost of incentives calculated by:

$$C_{incentives} = \sum_{h=1}^{n_{hours}} x_{inc} y_1 h \quad \$, \quad (20)$$

where  $C_{incentives}$  is the monthly cost of incentives,  $h$  is hours,  $n_{hours}$  is the number of hours for which the system generates electricity,  $x_{inc}$  is the performance incentive and  $y_1$  is the power output.

Another cost component of the objective function is the monthly cost of propane, obtained from the unit cost of propane [25].

### 3.4. Optimisation Strategy

This section describes the optimisation strategy used. The Tabu list, the neighbourhood, the termination criterion and the constraints are described. The use of pareto solutions to evaluate the objective function is also described.

Four variables are selected for use in solving the optimisation problem. Three of the variables i.e. the backup propane mass flow rate ( $u_1$ ), the biogas sharing ratio ( $u_2$ ) and the digester volume flow rate ( $u_4$ ) vary on a monthly basis. The fourth variable the induction machine rating ( $u_3$ ) is fixed for all the months of the year. In order to simplify the optimisation problem, the Tabu Search is run with the three variables that vary monthly, for a fixed induction machine rating (variable  $u_3$ ). The objective function (16) is modified to a cost vector:

$$\vec{z} = [C_{propane}, C_{grid\_electricity}], \quad (21)$$

Boiler Rating Range (kW)	Cost (\$)
53.62 - 97.57	3325
97.57 - 118.08	3405
118.08 - 150.60	4855
150.60 - 182.83	5310
182.83 - 212.13	5815

Source: Pumps and Pressure, 2011.

where  $\vec{z}$  is a cost vector,  $C_{\text{propane}}$  is the monthly cost of propane and  $C_{\text{grid.electricity}}$  is the monthly cost of grid electricity. Once the minimum cost is obtained from (21) for the different induction machine ratings (variable  $u_3$ ), the objective function (16) is evaluated to determine the maximum revenue.

The Tabu Search is implemented by sampling each of the three variables ( $u_1$ ,  $u_2$  and  $u_4$ ) for a given neighbourhood. The month for which the optimisation is to be carried out is selected based on the optimisation strategy. The neighbourhood of the variable is defined as:

$$\mathcal{N}(u)^{\text{new}} = \left\{ \begin{array}{ll} v : v = u_i^m + \delta_i & i = 1, 2, 4 \\ v = u_i^m - \delta_i & m = 1, 2, 3, \dots, 12 \end{array} \right\}$$

$LB_v \leq v \leq UB_v : v \in \mathcal{N}(u)$ .

where  $\mathcal{N}(u)$  is the neighbourhood of the variable  $u_i^m$ ,  $LB_v$  is the lower bound of the neighbourhood and  $UB_v$  is the upper bound of the neighbourhood. The move from  $u_i^m$  to  $u_i^m \pm \delta_i$  is selected within specific limits and step sizes. These step sizes and limits are defined in Section 1.

A Tabu list is formulated from moves that result in the current solution. Each entry of the Tabu list is a vector of the move and its associated month. Reverse moves are also included in the Tabu list. The Tabu list includes a random number selected within a given interval, that decides for how many iterations a Tabu condition persists.

The Tabu Search algorithm is terminated if no improvement of the incumbent solution has been observed after  $n_{\text{max.stop}}$  iterations.

There are six sets of constraints for this optimisation problem which are defined as:

$$(1 - u_2)m_{\text{biogas}} \leq m_{\text{biogas}}^1, \quad (22)$$

$$d_h \leq y_2 \leq (d_h + \delta_h), \quad (23)$$

$$(v_{\text{in}}^m d^m + V_{\text{lagoon}}^{m-1} - u_4^m d^m) \geq 0 \quad \text{for } m = 1, 2, 3, \dots, 12, \quad (24)$$

$$V_{\text{lagoon}}^m \leq v_{\text{in}} V_{\text{capacity.lagoon}} \quad \text{for } m = 1, 2, 3, \dots, 12, \quad (25)$$

$$\text{HRT } u_4^m \leq V_D \quad \text{for } m = 1, 2, 3, \dots, 12, \quad (26)$$

$$b_r = \max(d_h) - Q_{\text{HEX}} + \delta_b, \quad (27)$$

where  $u_2$  is the variable backup propane mass flow rate,  $m_{\text{biogas}}$  is the mass flow rate of biogas from the digester,  $m_{\text{biogas}}^1$  is the mass flow rate of biogas required to generate rated power,  $d_h$  is the heating demand,  $y_2$  is the heat output,  $\delta_h$  is the heating demand allowance,  $v_{\text{in}}$  is the volume flow rate of manure from

the cows,  $d$  is the number of days in the month,  $V_{\text{lagoon}}$  is the volume of manure in the lagoon,  $u_4$  is the variable digester volume flow rate,  $V_{\text{capacity.lagoon}}$  is the storage capacity of the lagoon, HRT is the hydraulic retention time of the digester,  $V_D$  is the volume of the digester,  $b_r$  is the boiler rating,  $Q_{\text{HEX}}$  is the output of the heat exchanger and  $\delta_b$  is the boiler rating allowance.

Infeasible solutions may be generated during the optimisation process if the constraints are not met. Infeasible solutions are allowed in the Tabu Search optimisation. It is good to allow infeasibility for non-convex constraints in order to shorten the path towards an optimal solution.

Two cost components are being evaluated in the cost vector (21). The Pareto optimal front method is used to ensure that the costs are non-dominating. To obtain Pareto optimal solutions, each cost component is summed separately for the whole year to form a solution vector. The solution vectors are then checked for non-dominance. Only the non-dominated solutions are retained. For a particular iteration, the best solution is selected as the minimum of the non-dominated solutions.

## 4. Results of the Optimisation

A sample farm of herd size 500, A.A. dairy farm [6] was selected for testing of the optimisation algorithm. The farm has a plug flow digester. This section presents and analyses the results of running the Tabu Search optimisation for the sample farm. The results are compared with the currently installed biomass waste to energy conversion system on the sample farm. The sample farm has a 130 kW engine-generator set and a 1133 m<sup>3</sup> digester that processes 85,000 gallons of manure daily [6].

### 4.1. Electrical Energy Generation

The tariff structure [31] in the Tabu Search is such that the considered cost of energy is higher in the months of January, February, June, July, August, and December for an 8 hour on-peak period. The results of the Tabu Search optimisation show high generation of power in these months for the 150hp, 200hp and 250hp engine-generator sets (Figures 2, 3 and 4 respectively), with some exceptions. It is beneficial to the farmer to generate as much electricity as possible during these months, for sale to the utility company.

For the 150hp engine-generator set, there are discrepancies in the months of February and December. The month of February has a low power output because the lagoon is building up manure storage for power production during the high demand months of March, April and May. The Tabu Search algorithm maximises revenue and thus avoids solutions that would lead to electricity production that does not meet the demand, hence the build up of manure storage. Manure storage is also being built up for use in the months of June, July and August when tariffs are high. The month of December has a low power output because manure is being stored in the lagoon for use in January. Since the electricity tariff for December and January

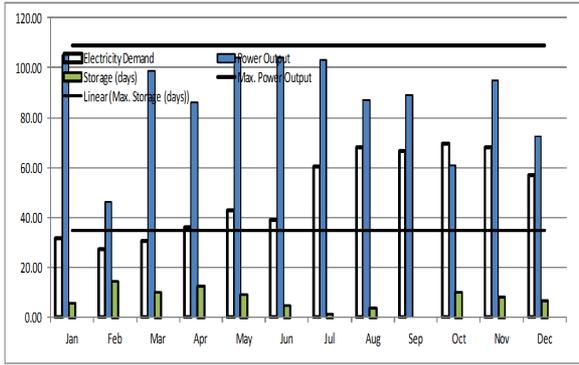


Figure 2: Power Output Profile for 150hp Engine-Generator Set

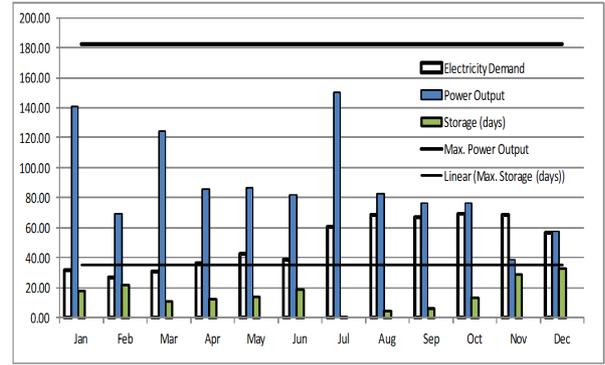


Figure 4: Power Output Profile for 250hp Engine-Generator Set

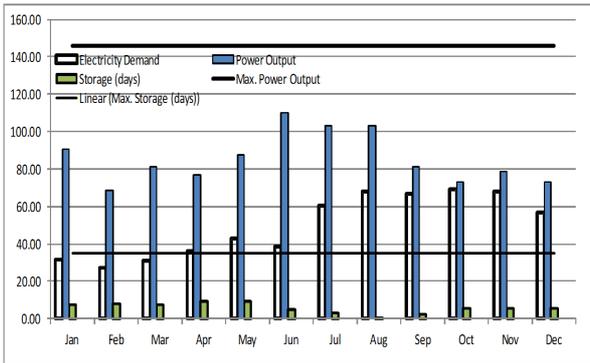


Figure 3: Power Output Profile for 200hp Engine-Generator Set

398 is the same, the result is acceptable because the manure is used  
 399 to generate electricity in January when it is sold to the utility  
 400 company at a high tariff.

401 The 200hp engine-generator system has high electricity gener-  
 402 ation in January, June, July and August in line with the high  
 403 electricity tariffs for these months. The months of February  
 404 and December have lower than expected electricity production  
 405 for this engine-generator set. This is because manure is being  
 406 built up in the lagoon to generate electricity in January, June,  
 407 July and August.

408 The electricity generation profile for the 250hp engine-  
 409 generator set is shown in Figure 4. Of all the engine-generator  
 410 set systems, the 250hp system gives the highest revenues from  
 411 the renewable energy incentives and sale of electricity as shown  
 412 in Table 7. The 200hp system gives a revenue of \$68654  
 413 and the 250hp system gives a revenue of \$72978, whereas the  
 414 150hp engine-generator set system gives a revenue of \$70457.  
 415 The high revenue of the 250hp engine-generator system is off-  
 416 set by its high capital cost. The highest net revenue is ob-  
 417 tained from the 150hp engine-generator system. Electricity  
 418 generation is not maximised for the 200hp and 250hp engine-  
 419 generator systems. This is due to an insufficient supply of  
 420 biogas. Figure 3 for the 200hp system shows that the lagoon  
 421 almost empties in August, and has very little manure left in  
 422 July and September, yet maximum electricity generation is not  
 423 achieved for any of the months. This applies to the 250hp sys-  
 424 tem as well. Figure 4 for the 250hp system shows that the

425 lagoon empties in July, yet maximum electricity generation is  
 426 not achieved for any of the months. Thus the system with the  
 427 150hp engine generator set is the most suitable for a farm with  
 428 a herd size of 500 dairy cows.

429 The electricity generation profiles of the 50hp and 20hp  
 430 engine-generator sets are as expected (Figure 5 and 6 respec-  
 431 tively). There is almost maximum electricity generation for all  
 432 the months. These are engine-generator sets of low power rat-  
 433 ing and therefore electricity production is maximised in order  
 434 to meet the farm's needs. It is assumed that production begins  
 435 in September in the first year of use. The lagoon storage size  
 436 is set to 90 days, hence the build up of manure stored from  
 437 September of one year to August of the next year. The lagoon  
 438 will always have a large amount of manure left over at the end  
 439 of the period, which is taken as September in this case.

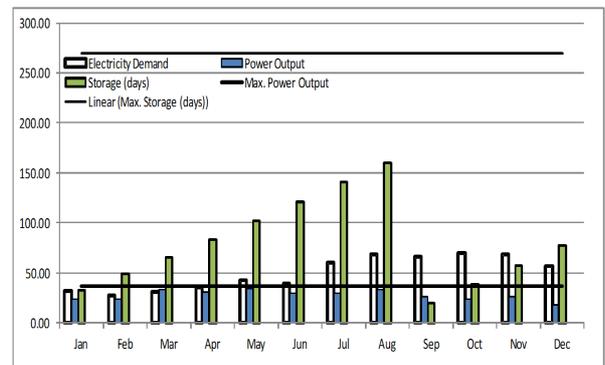


Figure 5: Power Output Profile for 50hp Engine-Generator Set

440 The 10hp engine-generator set's electricity generation pro-  
 441 file (Figure 7) also shows maximisation of power generation  
 442 throughout the year except for the month of November. This  
 443 discrepancy is attributed to the parameters used in the Tabu  
 444 Search optimisation. These are the same parameters as those  
 445 used for the 20hp engine-generator set system, which has dou-  
 446 ble the power rating. The parameters of the Tabu Search opti-  
 447 misation require further tuning for the 10hp engine-generator  
 448 set system.

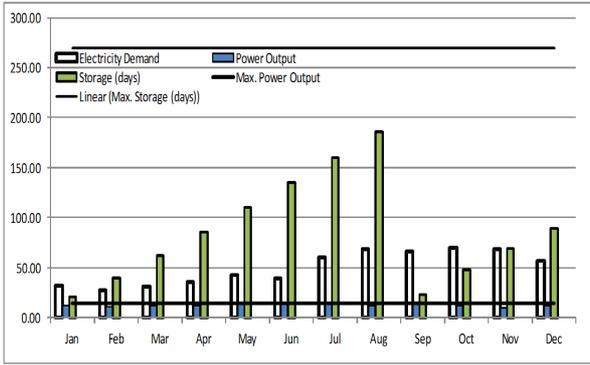


Figure 6: Power Output Profile for 20hp Engine-Generator Set

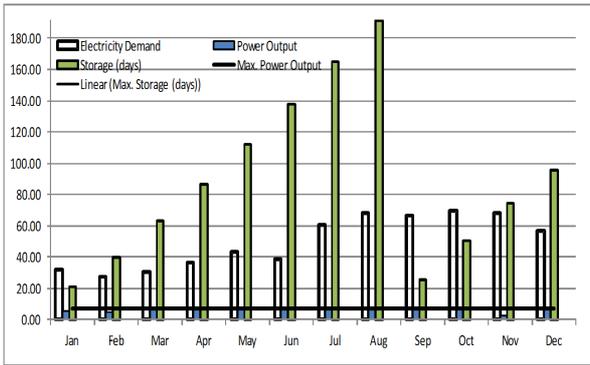


Figure 7: Power Output Profile for 10hp Engine-Generator Set

#### 4.2. Heat Generation

The heat production profile vs. heat demand profile for the 150hp engine-generator set system is shown in Figure 8. The profile shows that heating demand is met at all times. This applies to all the engine-generator systems.

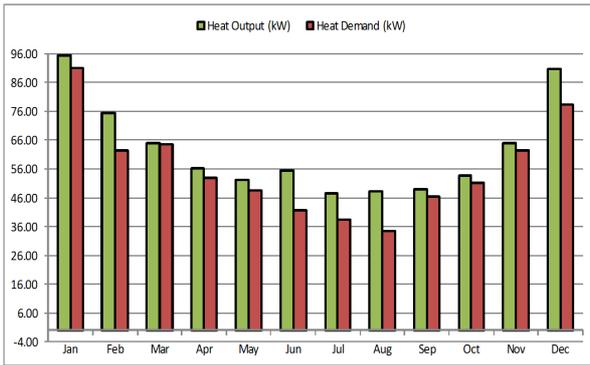


Figure 8: Heat Output Profile and Cost of Propane for 150hp Engine-Generator Set

#### 4.3. Evaluation of Maximum Revenue

The maximum revenue that can be obtained from a biomass waste to energy conversion system on the sample farm with a herd size of 500 dairy cows is evaluated using the objective

function (16). Table 7 summarises the revenue from the different engine-generator set ratings.

Table 7: Summary of Costs for Different Engine-Generator Set Ratings

Eng.-Gen. Set Rating	Cost of Capital (\$)	Cost of Propane (\$)	Cost of Incentives (\$)	Cost of Grid Elec. (\$)	Total Cost (\$)
10hp	21436	0	-3668	19301	37069
20hp	21821	2	-7529	16537	30831
50hp	24499	7	-17086	9847	17267
150hp	36526	49	-53967	-16490	-33882
200hp	38455	0	-52570	-16084	-30199
250hp	40613	62	-54999	-17979	-32303

The 50hp, 20hp and 10hp engine-generator sets not only do not meet the electricity demand of the farm, but are unable to use all the manure generated. This results in the need to buy electricity from the utility company. For example, it is estimated that the farm will spend \$9847 per annum on electricity (Table 7), with the 50hp engine-generator set system. The farm will however earn \$17086 from renewable energy generation incentives. The capital costs of the system have to be factored in (Table 7), resulting in a net negative revenue of \$17267 per annum. This analysis applies to the 20hp and 10hp engine-generator systems. Systems with engine-generator sets of 50hp, 20hp and 10hp ratings are therefore not economically viable for a farm of herd size 500.

From Table 7 the solution with the 150hp engine-generator set gives the maximum revenue for a herd size of 500. The sizing of the components of the 150hp engine-generator set system is a digester of capacity 1350 m<sup>3</sup>, a lagoon of 40 days storage capacity and a boiler rated at 133 kW. The proposed digester volume flow rate and biogas volume flow rate to the engine-generator set are shown in Figures 9 and 10 respectively.

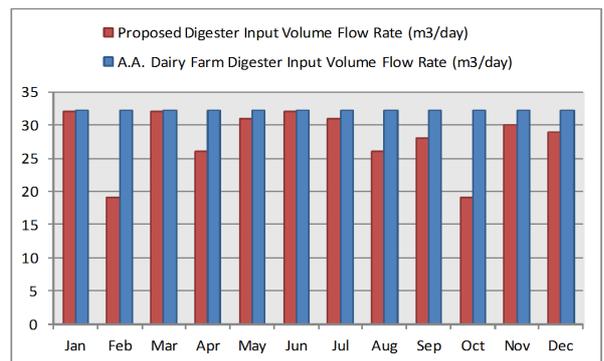


Figure 9: Digester Volume Flow Rate

The sample farm approximated its digester volume flow rate to 85,000 gallons per day [31], which translates to 32 m<sup>3</sup>/day for 500 cows in contrast to the value used of 28 m<sup>3</sup>/day for 500 cows [22]. This explains the higher digester volume flow rate for the sample farm (Figure 9).

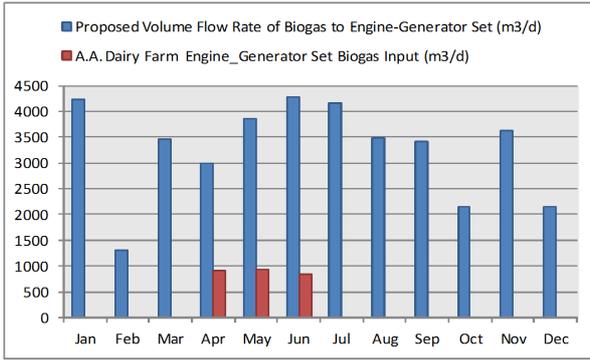


Figure 10: Volume Flow Rate of Biogas to Engine-Generator Set

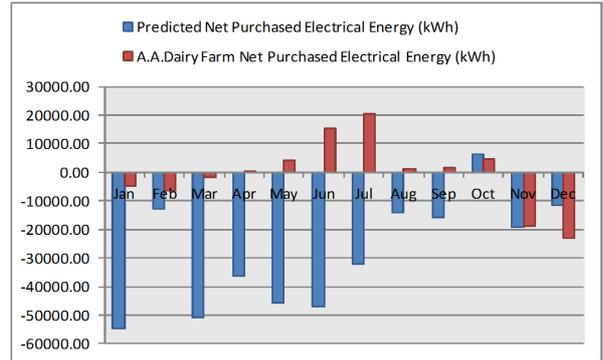


Figure 12: Net Electrical Energy Purchase

486 The cost of propane from the proposed system is shown in  
 487 Table 7. The minimal cost of propane is explained by the fact  
 488 that heat is supplied from combusting biogas in the boiler and  
 489 from exhaust heat captured by the heat exchanger. The Tabu  
 490 Search optimisation therefore minimises the cost of propane.

491 Data for the volume flow rate of biogas to the engine-  
 492 generator set on the sample farm was only available for three  
 493 months of the year hence the missing data in Figure 10. The  
 494 data available shows that a lower volume of biogas is sent to  
 495 the engine-generator set, despite the farm's engine generator  
 496 set having a higher rating than the proposed engine-generator  
 497 set. This is also reflected in the lower electricity production in  
 498 April, May and June (Figure 11), on the sample farm.

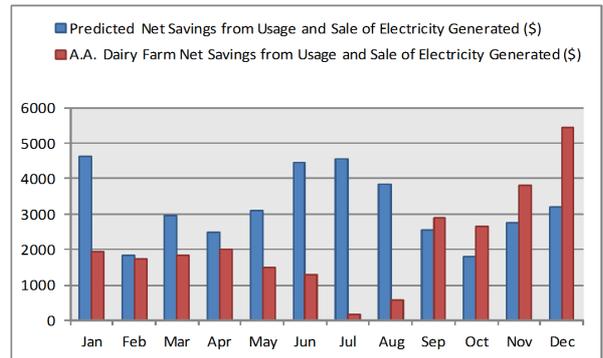


Figure 13: Net Savings from Usage and Sale of Electrical Energy Produced

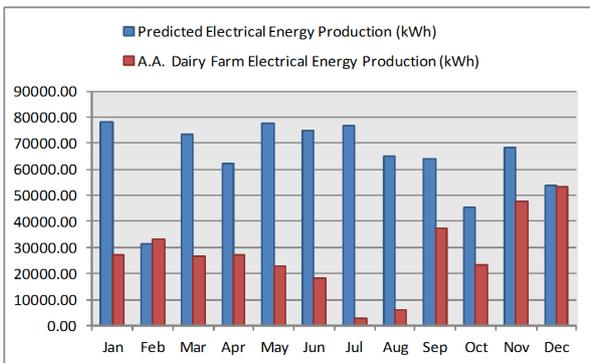


Figure 11: Electrical Energy Production

499 The installed energy generation capacity of the sample farm  
 500 is 175hp. It is more than what is required to generate maximum  
 501 revenue from a system with a herd size of 500. This capacity  
 502 is not being fully utilised. This is reflected in the net savings  
 503 shown in Figure 13. The sample farm saves \$25815 per annum  
 504 and the Tabu Search optimisation predicts a maximum revenue  
 505 of \$38133 per annum from the sale of electricity and avoidance  
 506 of usage of grid electricity. The sample farm is saving much  
 507 less money than what is predicted for a 150hp engine-generator  
 508 set system. Based on the analysis of the Tabu Search optimisa-  
 509 tion carried out, better utilisation of the installed generation  
 510 capacity will lead to 48% more cost savings for the sample  
 511 farm.

## 512 5. Conclusion

512

513 It has been shown that the problem of prediction of maxi-  
 514 mum revenue from a biomass waste to energy conversion sys-  
 515 tem can be solved using a Tabu Search optimisation technique.  
 516 The system model and the Tabu Search optimisation strategy  
 517 were described. A sample farm of herd size 500 was used to  
 518 test the Tabu Search optimisation. The results obtained showed  
 519 that maximised revenue is obtained with use of a 150hp engine-  
 520 generator set, a 1350 m<sup>3</sup> digester, a lagoon of 40 days storage  
 521 capacity and a boiler rated at 133 kW. The volume flow rate  
 522 of manure going into the digester and biogas going into the  
 523 engine-generator set were specified. Predicted electricity and  
 524 heat generation profiles were presented. The electricity genera-  
 525 tion profile was compared with the actual generation profile of  
 526 the sample farm. The monthly cost of a backup propane supply  
 527 was also specified. The predicted cost savings were compared  
 528 to actual data from the sample farm. The farm is under utilising  
 529 its currently installed system. From the Tabu Search optimisa-  
 530 tion carried out, better utilisation of the installed generation  
 531 capacity will lead to 48% more cost savings for the sample farm.  
 532 In conclusion, the Tabu Search optimisation algorithm devel-  
 533 oped can be used to predict the maximum revenue that can be  
 534 generated from a given herd size for a biomass waste to energy  
 535 conversion system. Further work in this area can be done on  
 536 modification of the algorithm to specify daily energy genera-  
 537 tion profiles, daily digester volume flow rates and daily biogas

538 volume flow rates.

## 539 Acknowledgment

540 This project is part of the R&D program of the NSERC  
541 Chair entitled Energy efficiency in electrical machines for  
542 small renewable energy production systems established in  
543 2009 at Concordia University. The authors acknowledge the  
544 support of the Natural Sciences & Engineering Research Council  
545 of Canada and Hydro-Quebec. Dr. Claude Laflamme of  
546 Hydro-Quebec Insitut de recherche is thanked for his comments.  
547

## 548 References

- 549 [1] J. Kramer, "Wisconsin Agricultural Biogas Casebook July 2008 Edition," [http://www.focusonenergy.com/files/document\\_management\\_system/renewables/biogas08\\_casestudy.pdf](http://www.focusonenergy.com/files/document_management_system/renewables/biogas08_casestudy.pdf), accessed March 2012.
- 550 [2] CDH Energy Corp., "Lamb Farms. Biogas-Driven Engine System," <http://cdhnrgr1.user.openhosting.com/Fact%20Sheets/Lamb%20Farms%20Fact%20Sheet.pdf>, accessed January 2011.
- 551 [3] NYSERDA, "DG/CHP Integrated Data System Sunnyside Farms," <http://chp.nysesda.org/facilities/details.cfm?facility=156>, accessed March 2012.
- 552 [4] CDH Energy Corp., "Swiss Valley Farms. Biogas-Driven Engine System," <http://cdhnrgr1.user.openhosting.com/Fact%20Sheets/Swiss%20Valley%20Fact%20Sheet.pdf>, accessed January 2011.
- 553 [5] C. Gooch, J. Pronto, "Anaerobic Digestion at AA Dairy: Case Study," <http://ww2.bse.vt.edu/green/Documents/Cornell%20Merged.pdf>, 2008, accessed March 2012.
- 554 [6] NYSERDA, "DG/CHP Integrated Data System A.A. Dairy," <http://chp.nysesda.org/facilities/details.cfm?facility=33>, accessed March 2012.
- 555 [7] New York State Environmental Investment Program, "Capital Project Summary Sheland Farms," <http://esd.ny.gov/businessPrograms/Data/EIP/EIPProjects/Organics-ShelandFarms.pdf>, accessed March 2012.
- 556 [8] NYSERDA, "DG/CHP Integrated Data System Sheland Farms," <http://chp.nysesda.org/facilities/details.cfm?facility=69>, accessed March 2012.
- 557 [9] H.K. House, D. Hilborn, "A Small Scale Anaerobic Digester Operating in Ontario-Klaesi Brothers Farm," [http://www.wcasfmra.org/biogas\\_docs/2010%20NRAES%20Paper%20-%20Klaesi%20Digester.pdf](http://www.wcasfmra.org/biogas_docs/2010%20NRAES%20Paper%20-%20Klaesi%20Digester.pdf), accessed March 2012.
- 558 [10] F. Glover, "Tabu Search - Part I," *ORSA Journal on Computing*, vol. 1, pp. 190-206, 1989.
- 559 [11] —, "Tabu Search - Part II," *ORSA Journal on Computing*, vol. 2, pp. 4-32, 1990.
- 560 [12] S.H. Chae, S.H. Kim, S. Yoon, S. Park, "Optimization of a Waste Heat Utilization Network in an Eco-industrial Park," *Applied Energy*, vol. 87, pp. 1978-1988, 2010.
- 561 [13] R. Murr, H. Thieriot, A. Zoughaib, D. Clodic, "Multi-objective Optimization of a Multi Water-to-Water Heat Pump System Using Evolutionary Algorithm," *Applied Energy*, vol. 88, pp. 3580-3591, 2011.
- 562 [14] A.A. Rentizelas, I.P. Tatsiopoulos, A. Tolis, "An Optimization Model for Multi-biomass Tri-generation Energy Supply," *Biomass and Bioenergy*, vol. 33, pp. 223-233, 2009.
- 563 [15] M. Bruglieri, L. Liberti, "Optimal Running and Planning of a Biomass-based Energy Production Process," *Energy Policy*, vol. 36, pp. 2430-2438, 2008.
- 564 [16] M. Gilli, P. Winker, "A Review of Heuristic Optimization Methods in Econometrics," Swiss Finance Institute Research Paper Series No. 8-12," <http://www.cigrjournal.org/index.php/Ejournal/article/viewFile/1288/1144>, 2008, accessed September 2011.
- 565 [17] IWA Task Group for Mathematical Modelling of Anaerobic Digestion Processes D.J. Batstone, J. Keller, I. Angelidaki, S.V. Kalyuzhnyi, S.G. Pavlostathis, A. Rozzi, W.T.M. Sanders, H. Siegrist, V.A. Vavilin, "Anaerobic Digestion Model No. 1 (ADM1)," 2002, IWA Publishing, 2002. Scientific and Technical Report. 1 900222 78 7.
- 566 [18] D.I. Page, K.L. Hickey, R. Narula, A.L. Main, S.J. Grimberg, "Modeling Anaerobic Digestion of Dairy Manure Using the IWA Anaerobic Digestion Model No. 1 (ADM1)," *Water Science & Technology*, vol. 58, pp. 689-695, 2008.
- 567 [19] N. Mohan, *Advanced Electric Drives Analysis, Control and Modeling using Simulink*. MNPERE, Minneapolis, ISBN 0971529205.
- 568 [20] C.V. Thomas, "Operations and Economic Models for Large Milking Parlors," Ph.D. dissertation, University of Florida, 1994.
- 569 [21] E.J. Hewett, "An Interactive Computer Simulation of Dairy Farm Systems as a Method for Making Energy Management Decisions," Ph.D. dissertation, Michigan State University, 1983.
- 570 [22] E.M. Barker, H.P. Neumann, "Sizing Dairy Manure Storage Facilities. British Columbia Ministry of Agriculture and Food. Farm Structure Fact Sheet." <http://www.agf.gov.bc.ca/resmgmt/publist/300Series/383100-2.pdf>, 1990, accessed September 2011.
- 571 [23] NYSERDA, "Renewable Portfolio Standard Customer-Sited Tier Anaerobic Digester Gas-to-Electricity Program. Program Opportunity Notice (PON) 2138," [www.nysesda.org/funding/2138pon.pdf](http://www.nysesda.org/funding/2138pon.pdf), accessed September 2011.
- 572 [24] M.A. Moser, K.F. Roos, "AgSTAR Program: Three Commercial Scale Anaerobic Digesters for Animal Waste, Making a Business from Biomass," in *Proceedings of the 3rd Biomass Conference of the Americas, Elsevier Science Inc., Tarrytown, NY*, 1997.
- 573 [25] U.S. Energy Information Administration, "Weekly Heating Oil and Propane Prices (October-March)," [http://www.eia.gov/dnav/pet/pet\\_pri\\_wfr\\_dcus\\_nus\\_w.htm](http://www.eia.gov/dnav/pet/pet_pri_wfr_dcus_nus_w.htm), accessed March 2010.
- 574 [26] C. Nelson, J. Lamb, "Haubenschild Farms Anaerobic Digester," <http://www.mnproject.org/pdf/Haubyrptupdated.pdf>, 2002, accessed September 2011.
- 575 [27] J.H. Martin, "A Comparison of Dairy Cattle Manure Management With and without Anaerobic Digestion and Biogas Utilization," <http://www.epa.gov/agstar/documents/nydairy2003.pdf>, 2004, accessed September 2011.
- 576 [28] —, "An Evaluation of A Mesophilic, Modified Plug Flow Anaerobic Digester for Dairy Cattle Manure," [http://www.epa.gov/agstar/documents/gordondale\\_report\\_final.pdf](http://www.epa.gov/agstar/documents/gordondale_report_final.pdf), 2005, accessed September 2011.
- 577 [29] J.M. Kramer, "Agricultural Biogas Casebook 2004 Update," <http://www.renewwisconsin.org/biogas/AD/Agricultural%20Biogas%20Casebook%202004%20Update.pdf>, 2004, accessed March 2012.
- 578 [30] Hot Water Boiler and Recirculating Pump Selection Chart and Distributor Price, <http://www.pumpsandpressure.com/docs/tech/Hot-Water-Boiler-Selection-Guide.pdf>, accessed September 2011.
- 579 [31] New York State Electric & Gas Corporation, "New York State Electric & Gas Corporation Rules, Regulations and General Information," 2005, Schedule for Electric Service.